
Installation Instructions

A100-A103

AS-i Megablock Series

1010.1 Equipment Information

Equipment Class III, Pollution Degree 1, Installation Category I

Maximum Altitude: 2000m

Humidity: 0 to 90% (non-condensing)

Electrical Supply Class: Class 2

Operating Temperature: -45°C to 70°C

For Indoor Use Only (IP 54 minimum enclosure)

Installation

Refer to the drawing 500-522, included in this document, as a typical installation of an AS-i Megablock. Actual segment connections may vary depending on factors such as the required number of AS-i devices to be connected to the segment (determines the specific models and quantities of AS-i Megablocks used).

Mounting

AS-i Megablocks are designed to be mounted on 35 mm DIN rail using the clip mechanism on the back of each unit. Mounting can be vertical or horizontal. Use of DIN rail end stops is recommended.

AS-i Megablocks must be installed inside an enclosure with a minimum rating of IP 54.

Once all wiring connections have been made, the retaining screws on each pluggable cable connector should be securely fastened.

Testing/Troubleshooting

Once DC power has been connected to the AS-i segment, the green power LED on the AS-i Megablock should be lit, indicating that a minimum of 9.7VDC is present on the segment trunk. **If the green LED is not lit**, verify the integrity and polarity of the trunk cable connections to the AS-i Megablock, that the voltage measured at the trunk connection to the AS-i Megablock is greater than 9.7VDC, that there are no shorts in the trunk cable, and that the power supply is operating properly.

On AS-i Megablock models with SpurGuard™ current limiters, verify that none of the red short circuit LED's are lit. **If any of the red short circuit LED's are lit**, remove the three-conductor plug from the affected spur connection. Locate and repair the short circuit on the spur cable before reconnecting.

On AS-i Megablock models with SpurGuard™ current limiters, verify that the red Fault LED is not lit. **If the red Fault LED is lit**, the SpurGuard™ current limiter circuitry has failed. Replace the AS-i Megablock as soon as possible to restore current limiting functionality.

Operation

During normal operation, the green power LED should be lit. If the green LED is not lit, follow the instructions in the testing/troubleshooting section above.

On AS-i Megablock models with SpurGuard™ current limiters, a lit red short circuit LED indicates a short in a spur cable or in the AS-i device connected to the spur cable. The LED will cease to be lit once the short has been repaired.

On AS-i Megablock models with SpurGuard™ current limiters, a lit red Fault LED indicates that the SpurGuard™ current limiter circuitry has failed. Replace the AS-i Megablock as soon as possible to restore current limiting functionality.

Maintenance Requirements


AS-i Megablocks contain no user serviceable parts. Non-functioning units should be returned to the manufacturer for replacement or repair.



Relcom Inc.

INDUSTRIAL LAN | WIRING COMPONENTS AND TESTERS

500-522: Class I, Division 2 (Zone 2) Installation

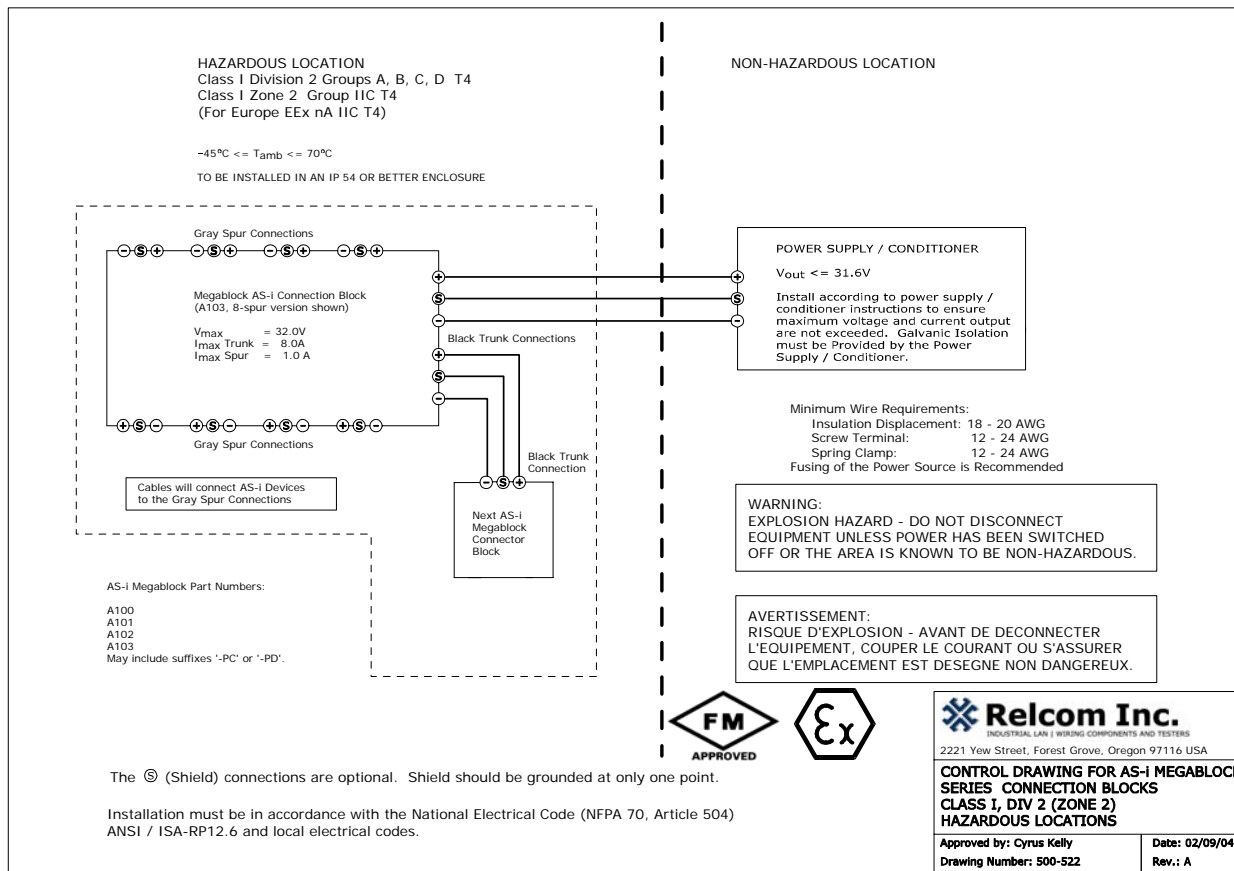

For Further Information

Contact your local MTL representative or Relcom Inc. as listed at the bottom of this page.

AS-i Megablock Series EMC Summary

European Union EMC Tests in accordance with EN61326 EMC Product Family Standard for measurement, control and laboratory equipment.

Test Items: **A101**

Other products conforming based on these test results include:

A100 A102 A103

**European Union Electromagnetic Compatibility (EMC) Tests
in accordance with EC Council Directive 89/336/EEC**

Emissions Tests per EN61326

Result	Standard	Description	Port	Comments
Pass	EN61326	Radiated Emissions	Enclosure	Class A
N/A	EN61326	Conducted Emissions	AC Mains	Test Not Required

Immunity Tests per EN61326 Annex A

Result	Standard	Description	Port	Criteria
Pass	EN61000-4-2	Electrostatic Discharge Immunity	Enclosure	B
Pass	EN61000-4-3	RF Electromagnetic Field Immunity	Enclosure	A
Pass	EN61000-4-4	Electrical Fast Transient/Burst Immunity	DC / IO Port	B
Pass	EN61000-4-5	Surge Immunity	DC / IO Port	B
Pass	EN61000-4-6	RF Conducted Immunity	DC / IO Port	A
N/A	EN61000-4-8	Magnetic Field Immunity	N/A	N/A
N/A	EN61000-4-11	Voltage Dips/Short Interruptions Immunity	N/A	N/A

I, Cyrus Kelly, representative for Relcom Inc., verify that the product tested is representative of production products to be sold.

